



Installation and Operation Instructions

LED T8 Tube Ballast Bypass / Line Voltage Series

Input Voltage: 120-277VAC 50/60 Hz

PRODUCT FEATURES

- UL Certified
- Full glass housing: No aging, yellowing or bending

PRODUCT APPLICATIONS

Widely used in residential buildings, offices, shopping malls, supermarkets, hospitals, assembly lines, warehouses, etc. for energy saving illumination.

WARNING – ATTENTION

Risk of fire or electric shock. Installation of this Retrofit Kit requires knowledge of electrical systems. If you are not qualified, do not attempt installation, and contact a qualified electrician.

Risque d'incendie ou de choc électrique. L'installation de ce kit rétrofit nécessite la connaissance des systèmes électriques. Si vous n'êtes pas qualifié, ne essayez pas de l'installation, et de communiquer avec un électricien qualifié.

Install this kit only in luminaires that have the construction features and dimensions shown in the photographs and drawings.

Installez ce kit en luminaires qui ont les caractéristiques de construction et dimensions indiquées dans les photographies et dessins.

Do not make or alter any holes, wiring enclosures, or electrical components during installation.

Ne pas créer ou modifier les trous, le câblage enclos, ou les composants électriques lors de l'installation.

To prevent damage to wiring, do not expose wires to the edges of sheet metal or other sharp objects.

Pour éviter d'endommager le câblage, ne pas exposer les fils sur les bords de tôle ou d'autres objets pointus.

To avoid potential fire or shock hazard, do not use this retrofit kit in luminaires utilizing shunted bi-pin lampholders.

Pour éviter un incendie ou un choc danger potentiel, ne pas utiliser ce kit d'adaptation dans des luminaires utilisant shuntés douilles à deux broches.




INSTALLATION INSTRUCTIONS

⚠ WARNING :

Risk of fire and electric shock. Disconnect power before installation and only use in a dry location.
This LED T8 lamp is not to be operated with other LED drivers
and is only for use with products described and installed in accordance with product specifications.

To ensure that this product is operated safely, please comply with these enclosed precautions and installation instructions.

Mounting - Electronic Ballast

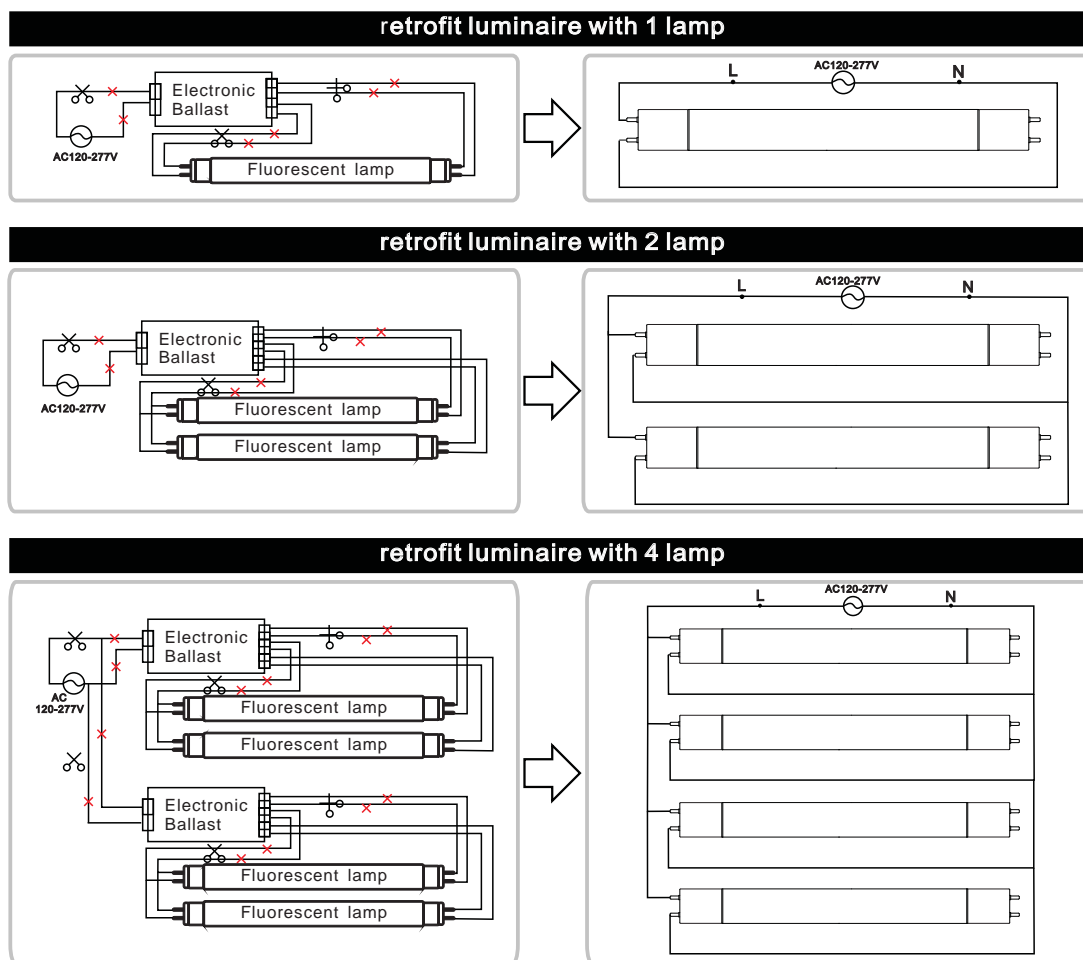

Mounting - Magnetic Ballast

